




ND30PNET - METER OF POWER NETWORK PARAMETERS WITH PROFINET

- Measurement of 54 power network parameters, including **current and voltage harmonics up to 51st**, in 1-phase 2-wire or 3-phase 3 or 4-wire balanced and unbalanced systems.
- **High accuracy class (0.2S for active energy).**
- **Graphical color display:** LCD TFT 3,5", 320 x 240 pixels, **fully configurable by a user** (10 views, 8 parameters in each).
- Indications include the values of programmed ratios.
- Memory of minimum and maximum values.
- 2 configurable alarm outputs.
- Optional: analog output 0/4...20 mA and 2 PT 100 inputs (eg. for measurement of transformer temperature).
- Digital output RS-485 - MODBUS protocol.
- **Modern and user-friendly Ethernet/Profinet (version 2.2.) interface.**
- Programming of parameters using **free eCon software**.
- Battery backup RTC.
- Overall dimensions: 96 x 96 x 77 mm.

EXAMPLE OF APPLICATION

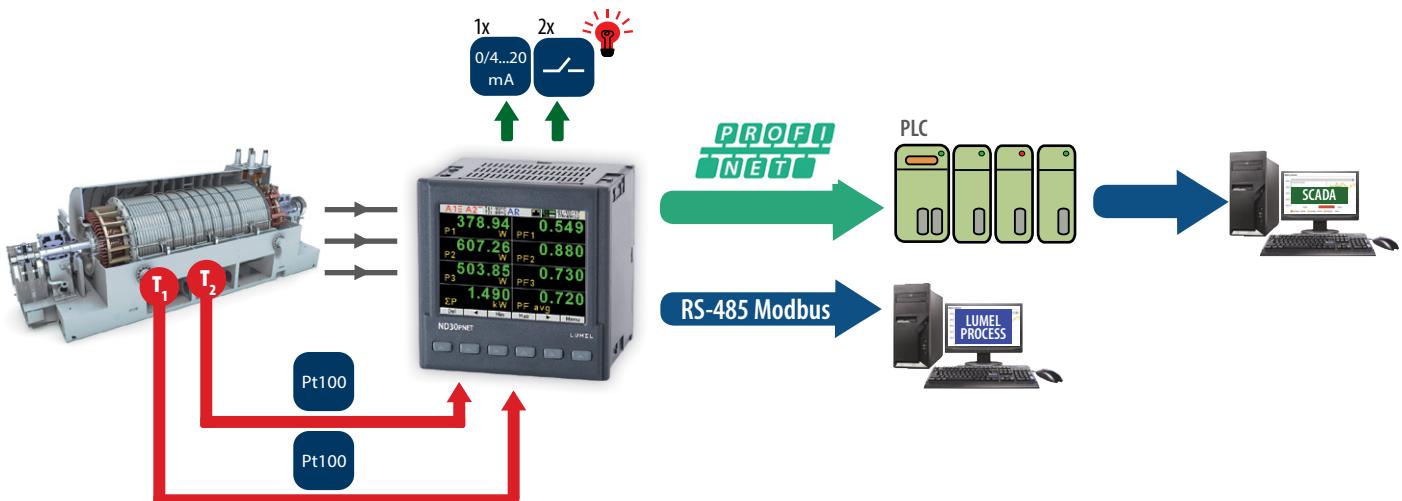

MEASUREMENT AND VISUALIZATION OF POWER NETWORK PARAMETERS

- phase voltages: U_1, U_2, U_3
- phase-to-phase voltages: U_{12}, U_{23}, U_{31}
- phase currents I_1, I_2, I_3
- active phase powers: P_1, P_2, P_3
- reactive phase powers: Q_1, Q_2, Q_3
- apparent phase powers: S_1, S_2, S_3
- active power factors: PF_1, PF_2, PF_3
- reactive/active power factors: $\text{tg}\varphi_1, \text{tg}\varphi_2, \text{tg}\varphi_3$
- active, reactive and apparent 3-phase power: P, Q, S
- mean 3-phase power factors: $PF, \text{tg}\varphi$
- frequency f
- mean 3-phase voltage: U_s
- mean phase-to-phase voltage: U_{mf}
- mean 3-phase current: I_s
- 15, 30, 60 minutes' mean active power: P_{demand}
- mean apparent power S_{demand}
- average current I_{demand}
- active, reactive and apparent 3-phase energy: EnP, EnQ, EnS
- active, reactive and apparent energy from external counter: $EnPE$
- total harmonic content coefficients for phase voltages and currents $\text{THD}_{U1}, \text{THD}_{U2}, \text{THD}_{U3}, \text{THD}_{I1}, \text{THD}_{I2}, \text{THD}_I$ and for 3-phase voltages and currents $\text{THD}_{U'}, \text{THD}_I$
- harmonics for current and phase voltage up to 51 st!
- temperature (2 x Pt100 input)

FEATURES	INPUTS	OUTPUTS	GALVANIC ISOLATION
     	 	   	        

TECHNICAL DATA

MEASURING RANGE

Measured value	Measuring range	L1	L2	L3	Σ	Class
Current 1/5 A 1 A~ 5 A~	0.002 ..0.100..1.200 A 0.010 ..0.500.. 6.000 A ...100.00 kA (tr _I ≠1)	.	.	.		0.2 (EN 61557-12)
Voltage L-N 57.7 V~ 110 V~ 230 V~ 400 V~	5.700..11.500..70.000 V 11.000..22.000..132.00 V 23.000..46.000 .. 276.00 V 40.000..80.000 .. 480.00 V ...1920.0 kV	.	.	.		0.2 (EN 61557-12)
Voltage L-L 100 V~ 190 V~ 400 V~ 690 V~	10.000 ..20.000..120.00 V 19.000 ..38.000..228.00 V 40.000..80.00 .. 480.00 V 69.000..138.00 .. 830.00 V ...1999.0 kV (tr _U ≠1)	.	.	.		0.5 (EN 61557-12)
Active power P	-19999 MW .. 0,000 W .. .19999 MW (tr _U ≠1,tr _I ≠1)	0.5 (EN 61557-12)
Reactive power Q	-19999 MVar .. 0,000 Var .. .19999 MVar (tr _U ≠1,tr _I ≠1)	1 (EN 61557-12)
Apparent power S	0.000 .. 1999.9 VA .. .19999 MVA (tr _U ≠1,tr _I ≠1)	0.5 (EN 61557-12)
Active energy EnP (imported or exported)	0.000 .. 99 999 999.999 kWh				.	0.25 (EN 62053-22)
Reactive energy EnQ (inductive or capacitive)	0.000 .. 99 999 999.999 kVarh				.	1 (EN 61557-12)
Apparent energy EnS	0.000 .. 99 999 999.999 kWh				.	0.5 (EN 61557-12)
Active power factor PF	-1.00 ..0..1.00	1 (EN 61557-12)
Coefficient tg (ratio of reactive power to active power)	-999.99...-1.20 .. 0 .. 1.20..999.99	1
Frequency f	45.00..65.00...100.00 Hz				.	0.1 (EN 61557-12)
Total harmonic distortion of voltage THDV and current THDI	0.0..100.0 %	5 (EN 61557-12)
Amplitudes of the voltage $U_{h2} \dots U_{h51}$ and current $I_{h2} \dots I_{h51}$	0.0..100.0 %	.	.	.		II (IEC61000-4-7)

tr_I - Current transformer ratio = Primary current of the transformer / Current of the current transformer,
tr_U - Transmission of voltage transformer = Primary voltage of the transformer / Secondary voltage of the voltage transformer

ADDITIONAL INPUTS

Input type	Properties
Input Pt100 (T1, T2) - option	2 x Pt100, 2-wire, -50..400°C, basic error 0.5 %
Binary inputs - option	0V d.c. – binary input inactive, 5...24V d.c. – binary input active

DIGITAL INTERFACE

Interface type	Transmission protocol	Remarks
RS-485	Modbus RTU 8N2,8E1,8O1,8N1	Address 1..247 baud rate: 4.8, 9.6, 19.2, 38.4, 57.6, 115.2 kbit/s
Ethernet / Profinet	ICMP (Ping) / Profinet version 2.2	

EXTERNAL FEATURES

Readout field	graphic color display LCD TFT 3,5", 320 x 240 pixels	
Overall dimensions	96 x 96 x 77 mm	mounting hole 92.5 x 92.5 mm
Weight	0.3 kg	
Protection grade	from frontal side: IP65	from terminal side: IP20


RATED OPERATING CONDITIONS

Supply voltage	→ 85...253 V a.c. (40...50...400 Hz), 90...300 V d.c. or 20...40 V a.c., 20...60 V d.c.	power consumption ≤ 6 VA
Power consumption	in voltage circuit ≤ 0.2 VA	in current circuit ≤ 0.1 VA
Input signal	0...0.1...1.2 In; 0.1...0.2...1.2 Un for current, voltage, PF, tgφ	frequency 45...50...60...100 Hz, sinusoidal (THD ≤ 8%)
Power factor	-1...0...1	
Preheating time	5 min.	
Ambient temperature	-10...23...55°C, class K55 acc. to EN61557-12	
Humidity	0...40...65...95%	without condensation
Operating position	any	
External magnetic field	≤ 40...400 A/m d.c.	≤ 3 A/m a.c. 50/60 Hz
Short-term overload	voltage input: 2 Un (5 sec.)	current input 50 A (1 sec.)
Admissible crest factor	current: 2	voltage: 2
Additional error (in % of the intrinsic error)		from ambient temperature change: < 50% / 10°C


SAFETY AND COMPABILITY REQUIREMENTS

Electromagnetic compatibility	noise immunity noise emissions	acc. to EN 61000-6-2 acc. to EN 61000-6-4
Isolation insured by the casing	double	acc. to EN 61010-1
Isolation between circuits	basic	acc. to EN 61010-1
Polution level	2	acc. to EN 61010-1
Installation category	III	acc. to EN 61010-1
Maximal phase-to-earth voltage	• for supply circuit and relay outputs 300 V • for measuring input 500 V • for circuits of RS-485, Ethernet, pulse input and output, analog outputs, temperature or binary inputs: 50 V	acc. to EN 61010-1
Altitude a.s.l.	< 2000 m	

CONNECTION DIAGRAMS

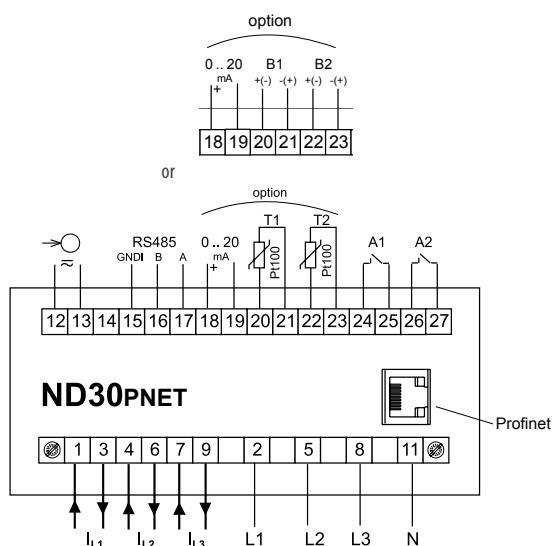

Description of meter connections strips

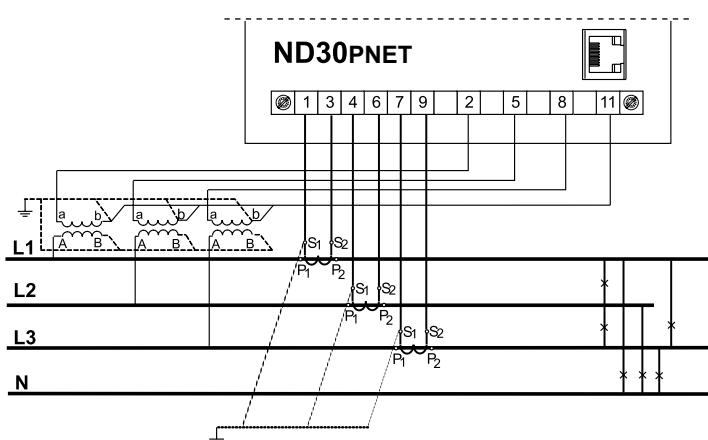

Indirect measurement in 4-wire network - connection of input signals

DISPLAYING OF MEASUREMENT PARAMETERS



A1	A2	T1: 52°C T2: 31°C	TX	15/03/16 11:33:16
225.48		I1	1.005	A
U1	V			
228.91		I2	2.105	A
U2	V			
231.22		I3	1.805	A
U3	V			
49.999	f	avg	1.638	A
Hz				
Del	<	Min	Max	> Menu

A1	A2	T1: 52°C T2: 32.9°C	TX	15/03/16 13:04:26
843.80		21 660 807.201	W	En P+ kWh
726.01		2 786 343.635	var	En P- kWh
1.126		13 760.862	kVA	En Q+ kvarh
24 853 934.200		12 035.698	kVAh	En Q- kvarh
En S	kVAh	En Q	# kvarh	
Del	<	Min	Max	> Menu

A1	A2	T1: 52°C T2: 37°C	TX	15/03/16 12:02:57
225.48	V	S1	226.57	VA
U1				
1.005	I1	PF1	0.913	A
206.88	P1	tg1	0.447	W
92.387	Q1	f	49.999	var
				Hz
Del	<	Min	Max	> Menu

up to 10 programmable screens
(8 parameters per page);
ability to change color for all screens


A1	A2	T1: 49°C T2: 53°C	TX	22/09/15 13:36:31
0.905	U1	I1	0.905	%
0.905	U2	I2	0.903	%
0.903	U3	I3	0.903	%
Har. 5				
50160	<	▼	▲	> Menu

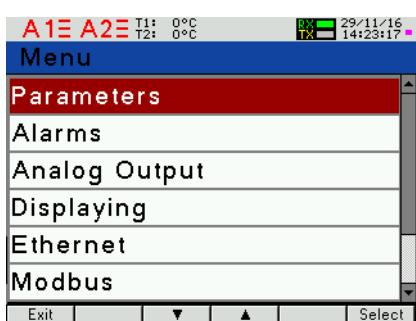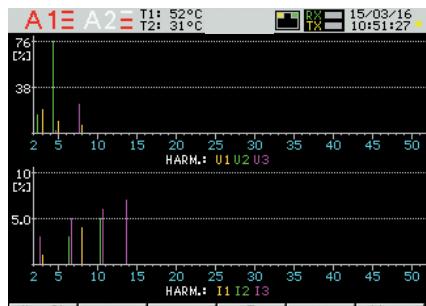

easy to use and intuitive menu;
information bar with status of: phase
sequence, alarm outputs, temperature
measurements, binary inputs*
and RS-485 interfaces,
time and date

*- availability of feature depends on
hardware version of ND30PNET

METER CONFIGURATION WITH FREE eCON SOFTWARE

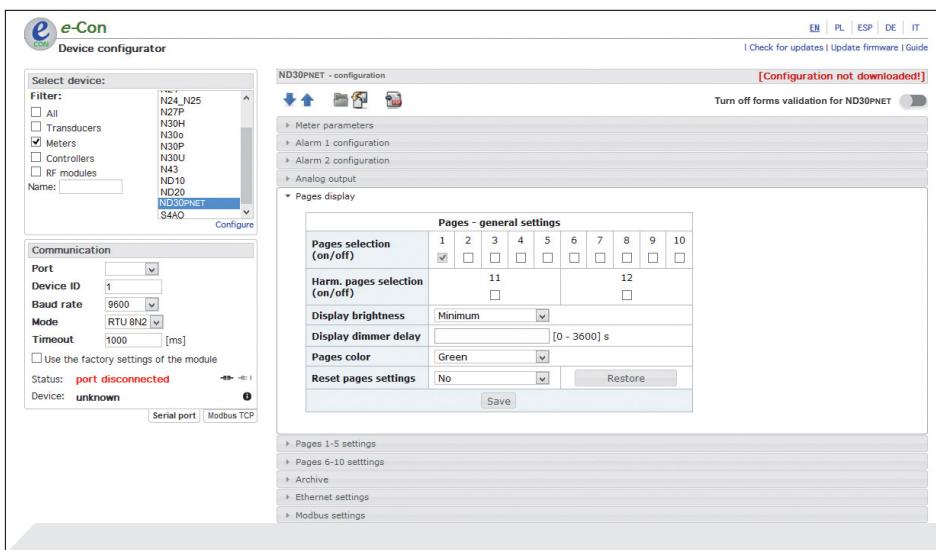

ability to configure and update ND30PNET
with free eCon software
(via RS-485)

*- availability of feature depends on hardware
version of ND30PNET

ORDERING CODE

ND30PNET	X	X	X	XX	X	X
Input voltage (phase/phase-to-phase) Un:						
3 x 57.7 / 100 V, 3 x 230 / 400 V	1					
3 x 110 / 190 V, 3 x 400 / 690 V	2					
Additional outputs /inputs:						
2 relays	1					
2 relays, 1 analog output, 2 inputs PT100	2					
2 relays, 1 analog output, 2 binary inputs (galvanically isolated)	3					
Supply:						
85...253 V a.c., 90...300 V d.c.	1					
20...40 V a.c., 20...60 V d.c.	2					
Version:						
standard		00				
custom-made*		XX				
Language:						
Polish/ English		M				
other*		X				
Acceptance tests:						
without additional quality requirements	0					
with an extra quality inspection certificate	1					
with calibration certificate	2					
acc.to customer's request*	X					

Order example:

The code: **ND30PNET_122100M0** means:

ND30PNET - meter ND30PNET

1 - input voltage 3 x 57.7 / 100 V, 3x 230 / 400 V

2 - 2 relays, 1 analog output, 2 inputs PT100

1 - supply: 85...253 V a.c., 90...300 V d.c.

00 - standard version

M - Polish/English language version

0 - without additional quality requirements.

* only after agreeing with the manufacturer

SEE ALSO:



ND40 - power network analyzer/ recorder



RE92 - dual loop controller



P30U - universal transducer
of temperature and standard signals



KS31 - Digital synchronizing unit



N43 - rail mounted 3-phase power network meter



P43 - 3-phase transducer
of power network parameters



ND1 - analyser
of network parameters



Current transformers
from 5 A up to 6 kA

For more information about Lumel products
please visit our website:

www.lumel.com.pl

Join us at Facebook!



ND30PNET-19B_en



LUMEL
EVERYTHING COUNTS

LUMEL S.A.

ul. Sulechowska 1, 65-022 Zielona Góra, POLAND
tel.: +48 68 45 75 100, fax +48 68 45 75 508
www.lumel.com.pl

Export department:

tel.: (+48 68) 45 75 139, 45 75 233, 45 75 321, 45 75 386
fax.: (+48 68) 32 54 091
e-mail: export@lumel.com.pl